



# RES4LIVE

ENERGY SMART LIVESTOCK FARMING  
TOWARDS ZERO FOSSIL FUEL CONSUMPTION

## **The effect of renewable energy transition on the thermal comfort in a pig farm Animal compartment level experimental investigation**

Petros D. Tegenaw, Manon Everaert, Marijke Aluwé, Steven Lecompte, Jarissa Maselyne

EAAP 2024

September 2024 Florence, Italy




This project has received funding from the European Union's Horizon 2020 research and innovation programme under grant agreement No.101000785





ILVO pig farm (Melle, Belgium)  
Farrow to finish - 105 sows, 600 piglets, 750 fattening pigs

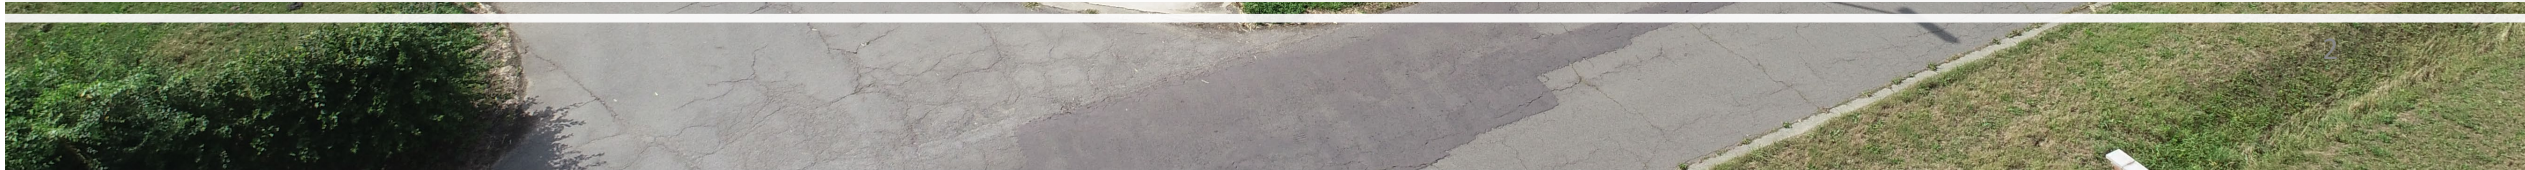



# Renewable energy transition at the ILVO pig farm

- Gas boiler with 220 MWh per year consumption





## RES4LIVE project

- Two modular heat pumps (24.5 kW and 39.5 kW)




# Heating of the pig farm with renewable energy sources

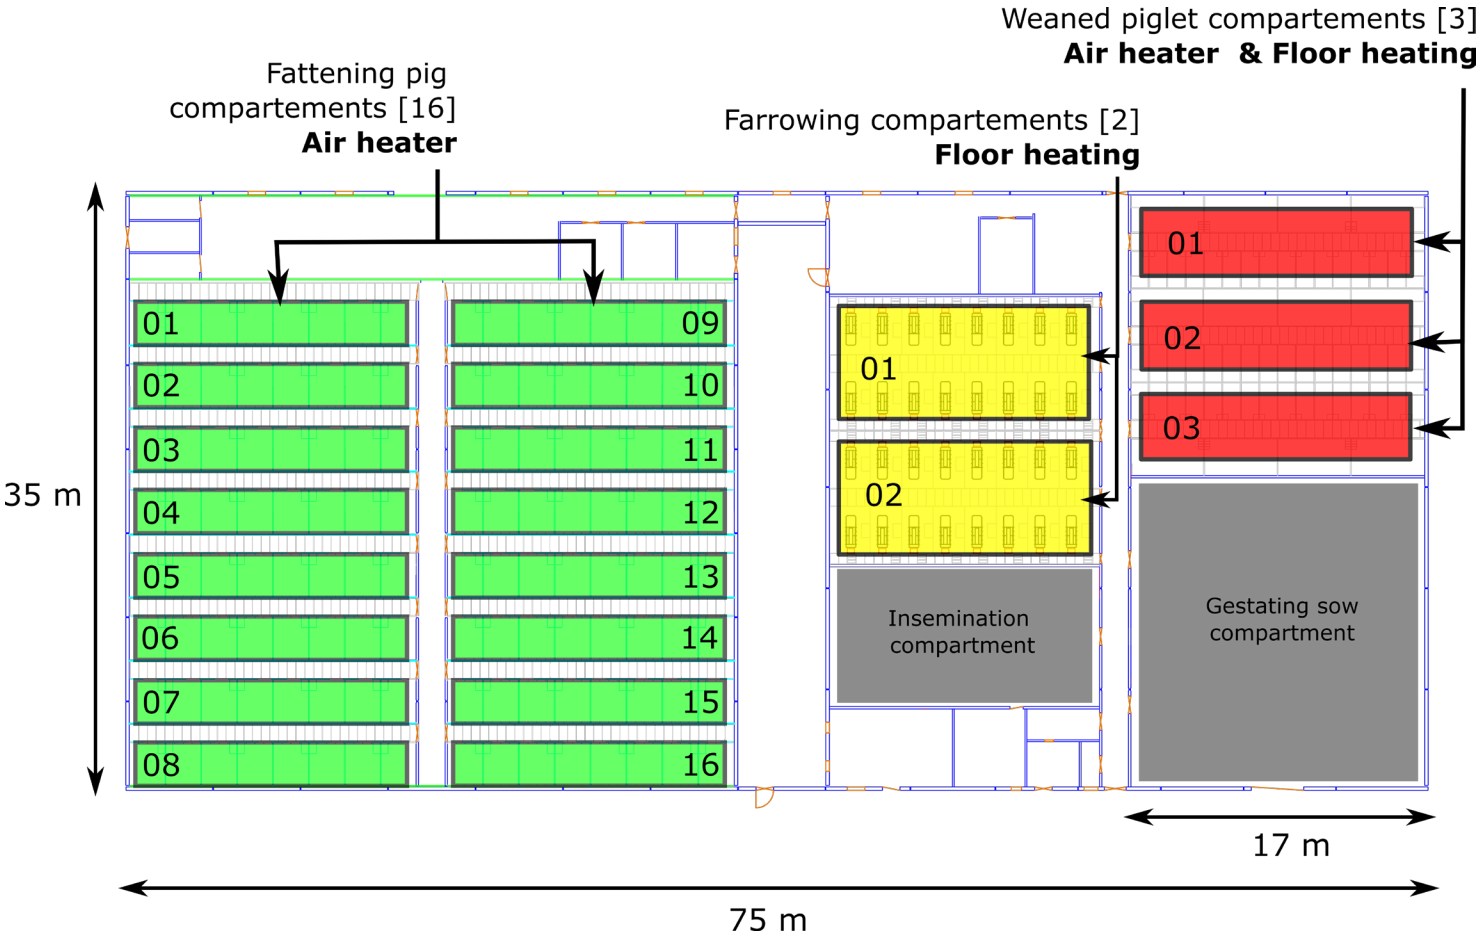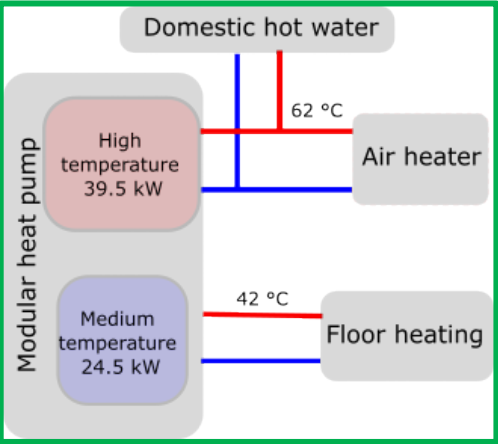




# Environmental measurement sensors & systems



Temperature sensors [22]  
• Pt1000



RH-Sensor [9]  
•  $\pm 2\%$

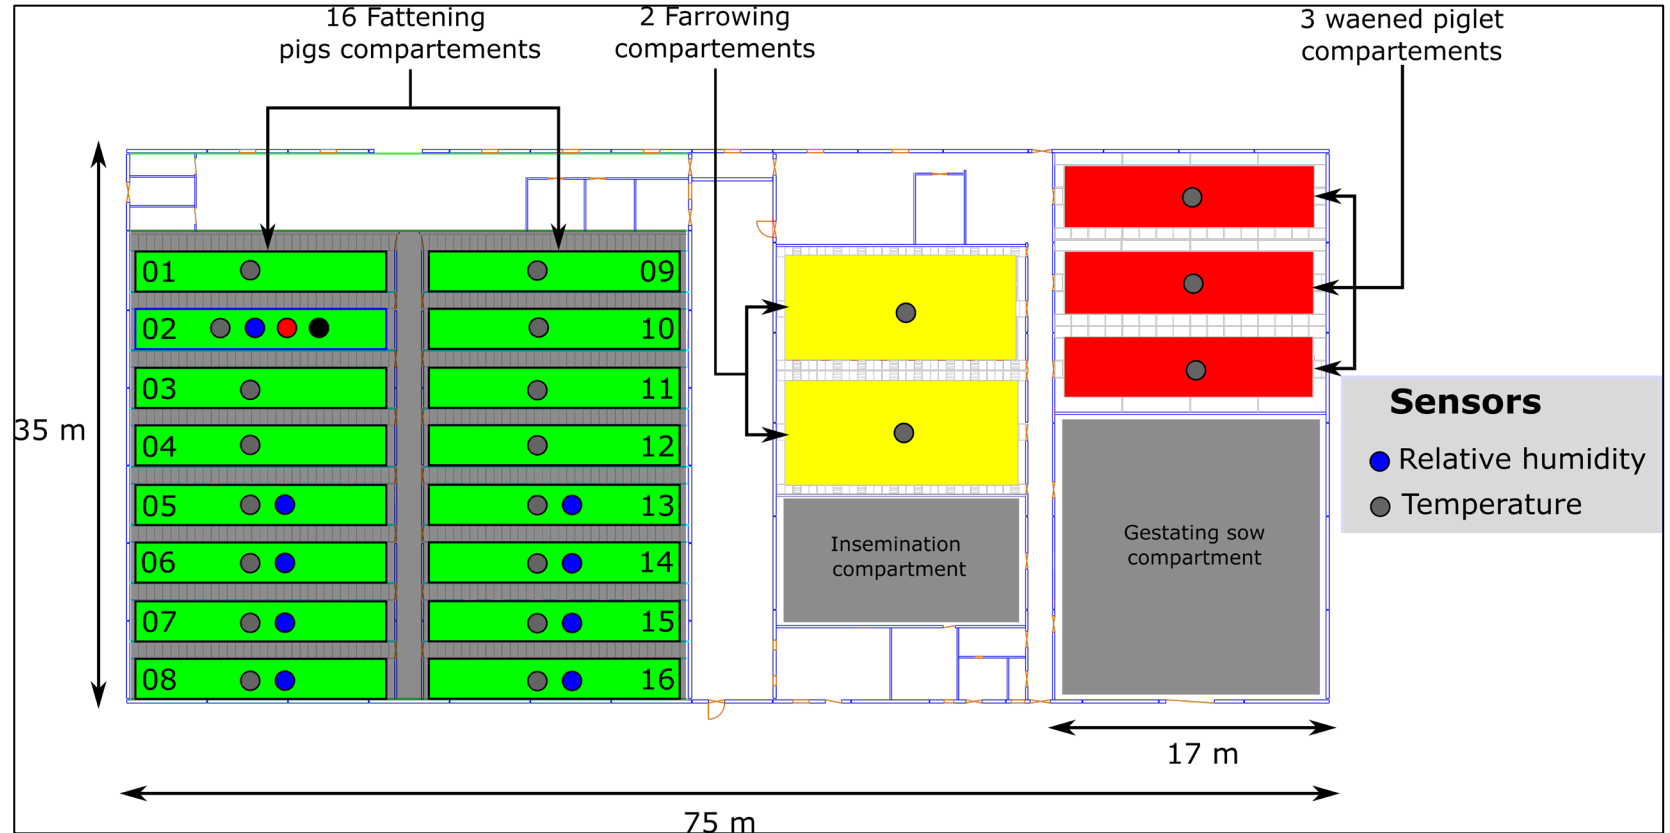

# Data analysis

- **Trial periods**
  - Gas boiler (7<sup>th</sup> May – 7<sup>th</sup> August 2023)
  - Heat pump (7<sup>th</sup> May – 7<sup>th</sup> August 2024)
- **Temperature, relative humidity, ambient temperature, every 10 min**
- **The data from the RH and T sensors were used to calculate the Temperature-Humidity Index (*THI*)**

$$THI = 0.72 * (T_{db} + T_{wb}) + 40.6$$

$$T_{wb} = T_{db} * \tan^{-1}(0.152 * (RH + 8.314)^{0.5}) + \tan^{-1}(T_{db} + RH) - \tan^{-1}(RH - 1.68) + 0.0039 * RH^{1.5} * \tan^{-1}(0.0231 * RH) - 4.686$$


Where  $T_{db}$  and  $T_{wb}$  are dry-bulb and wet-bulb temperatures [°C], and RH: relative humidity [%].

- 75 < THI < 79: warning for heat stress,
- 79 < THI < 84: danger for heat stress,
- THI > 84: great danger for heat stress


<https://doi.org/10.1016/j.animal.2024.101172>.



# Fattening pig compartments: Time evolution of daily average temperature – Gas boiler 2023


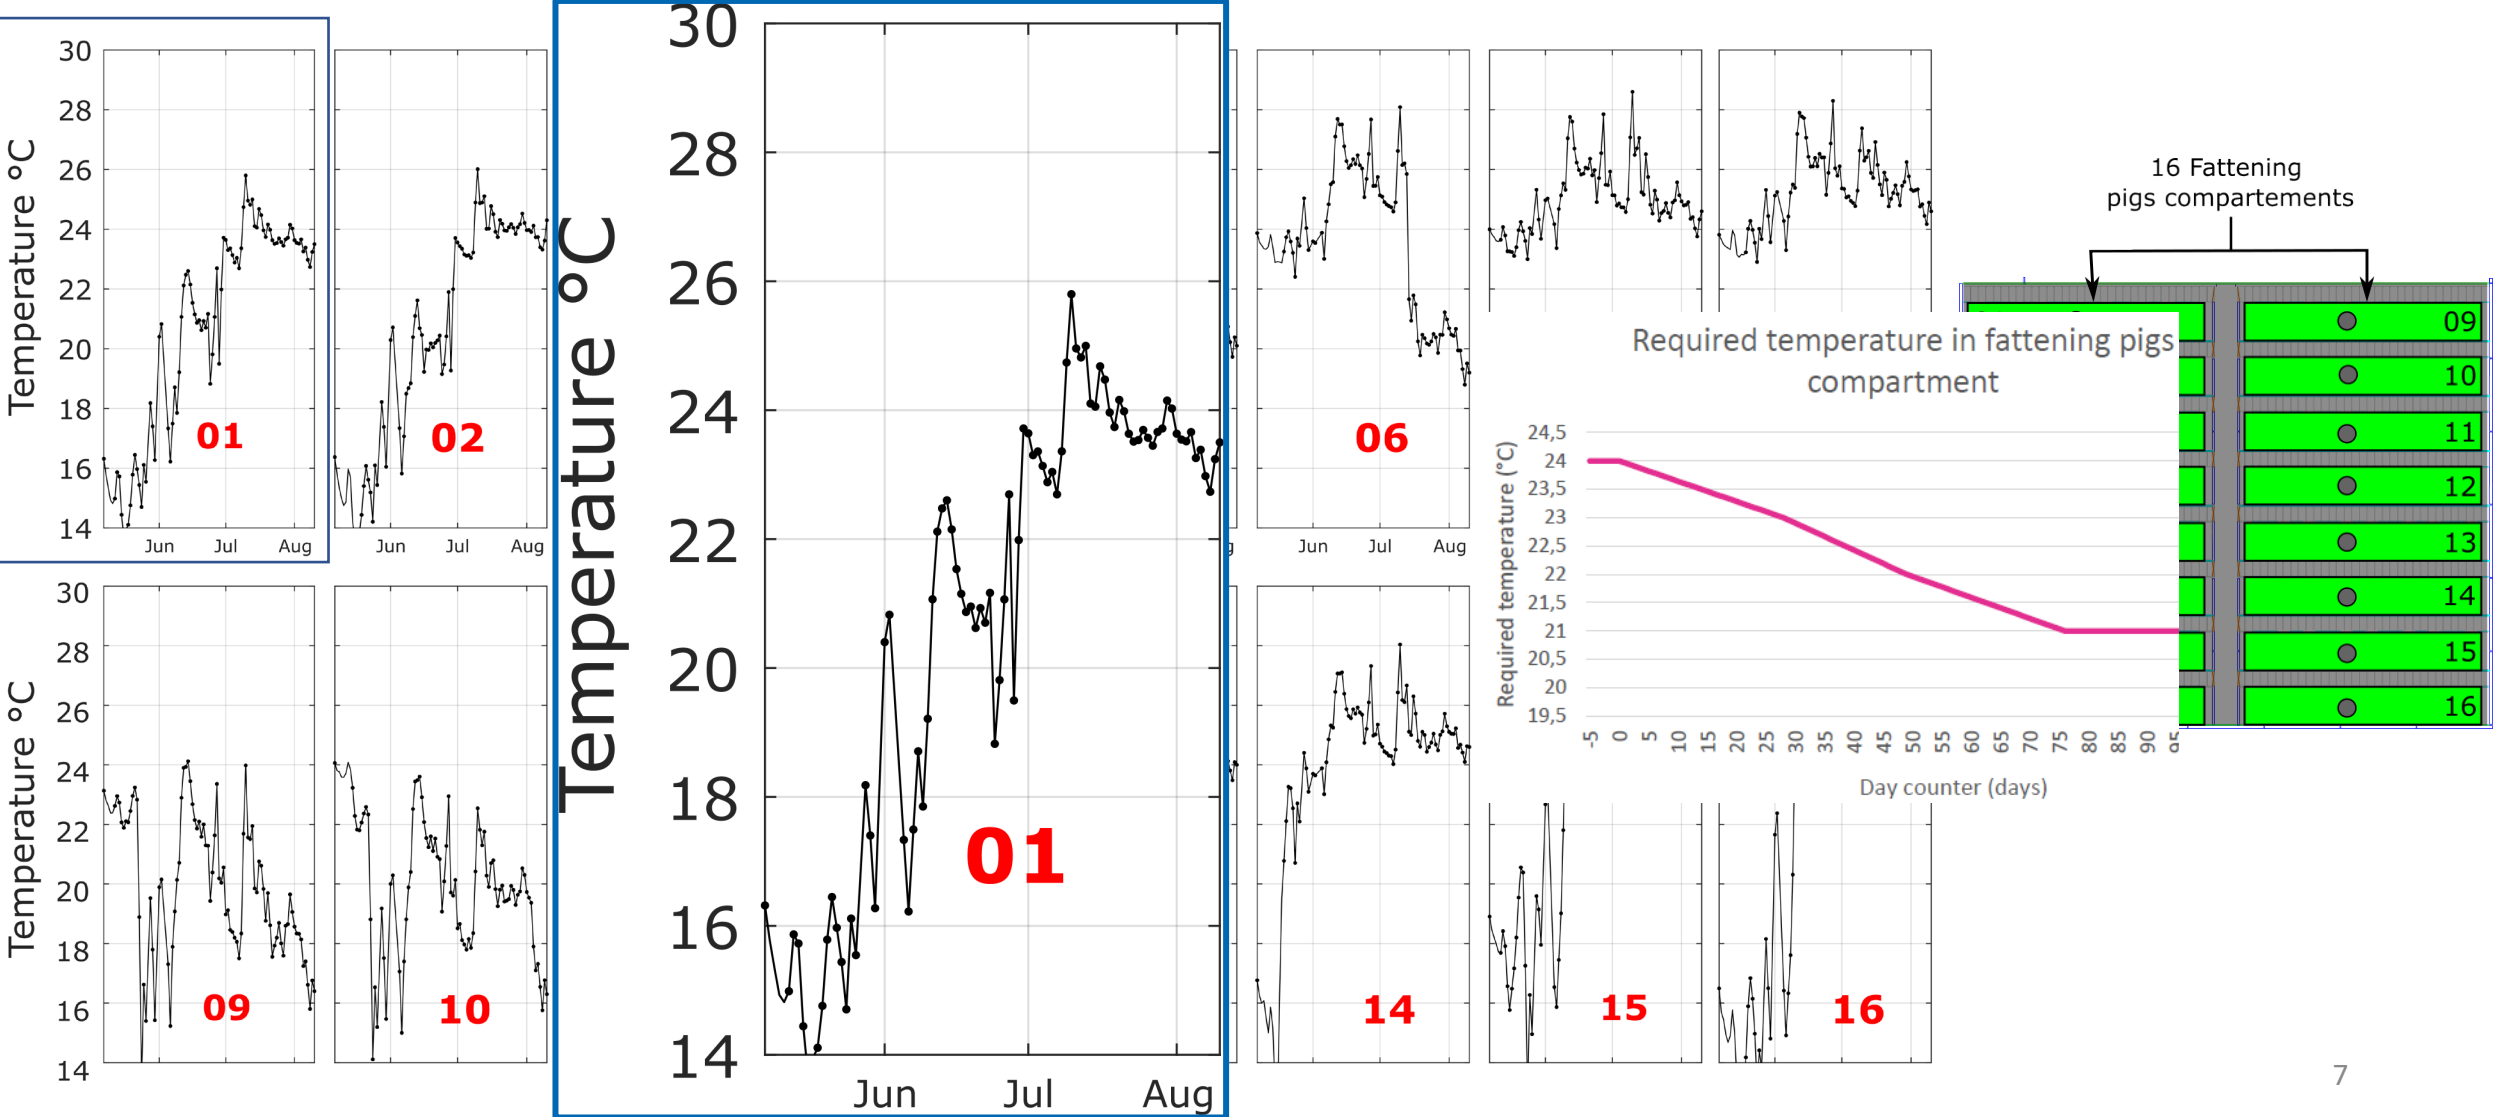


# Fattening pig compartments: Time evolution of daily average temperature – Heat pump 2024


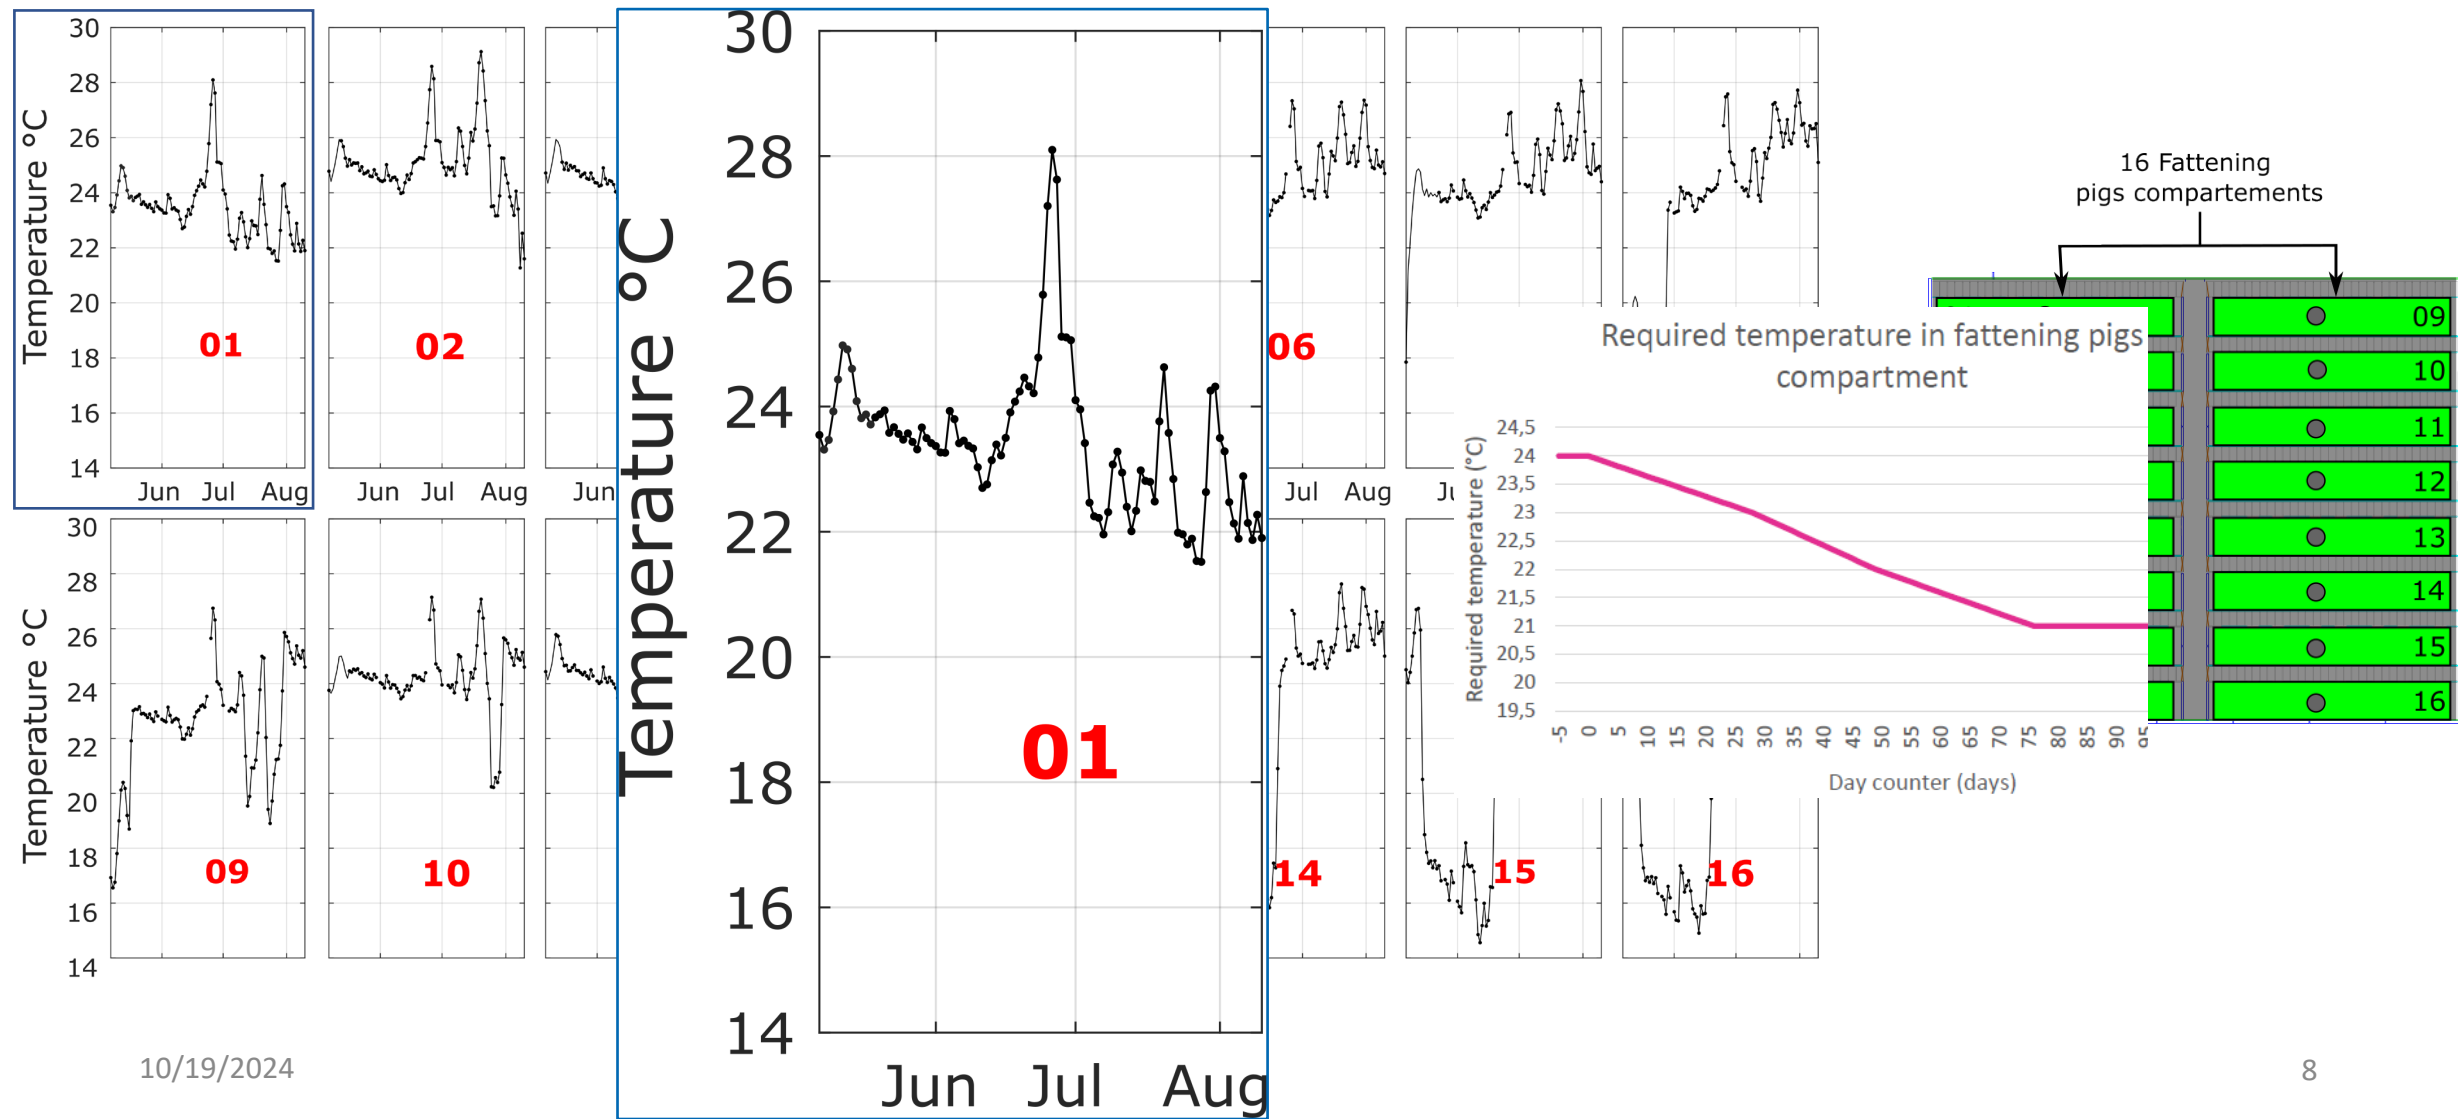





# Farrowing compartment: Time evolution of daily average temperature

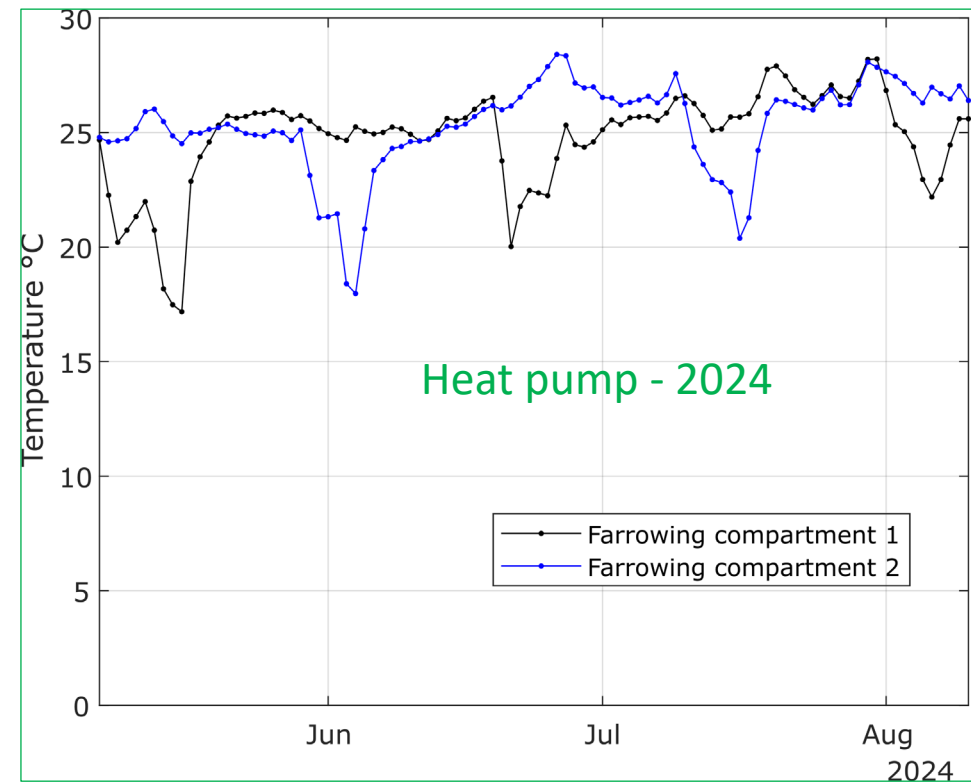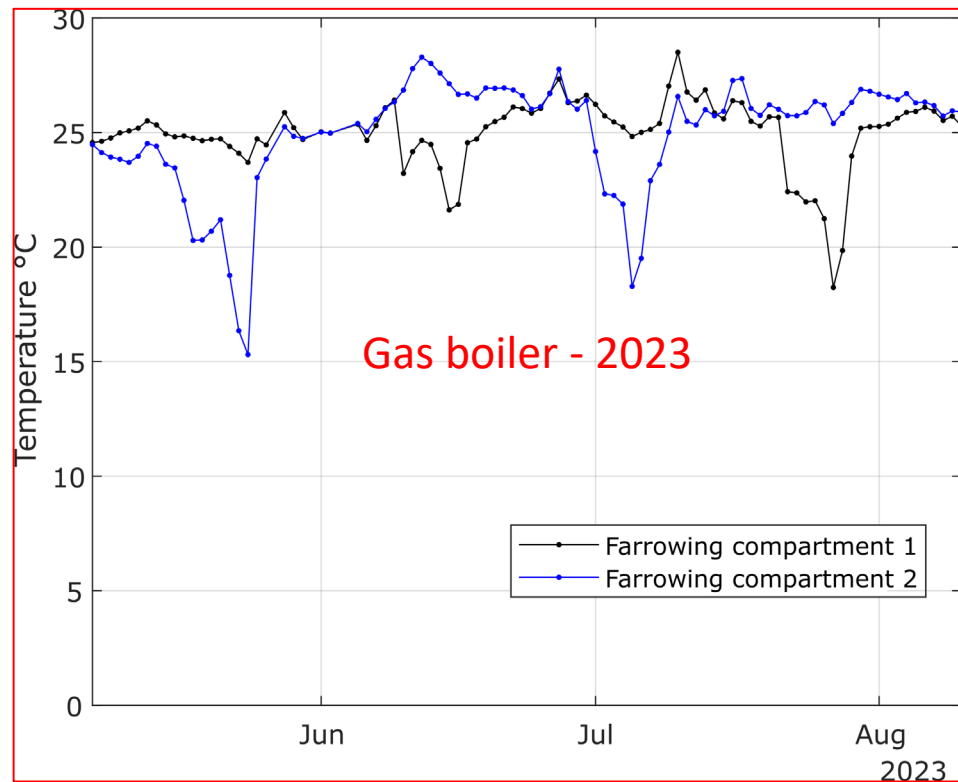

# Weaned piglet compartments: Time evolution of daily average temperature

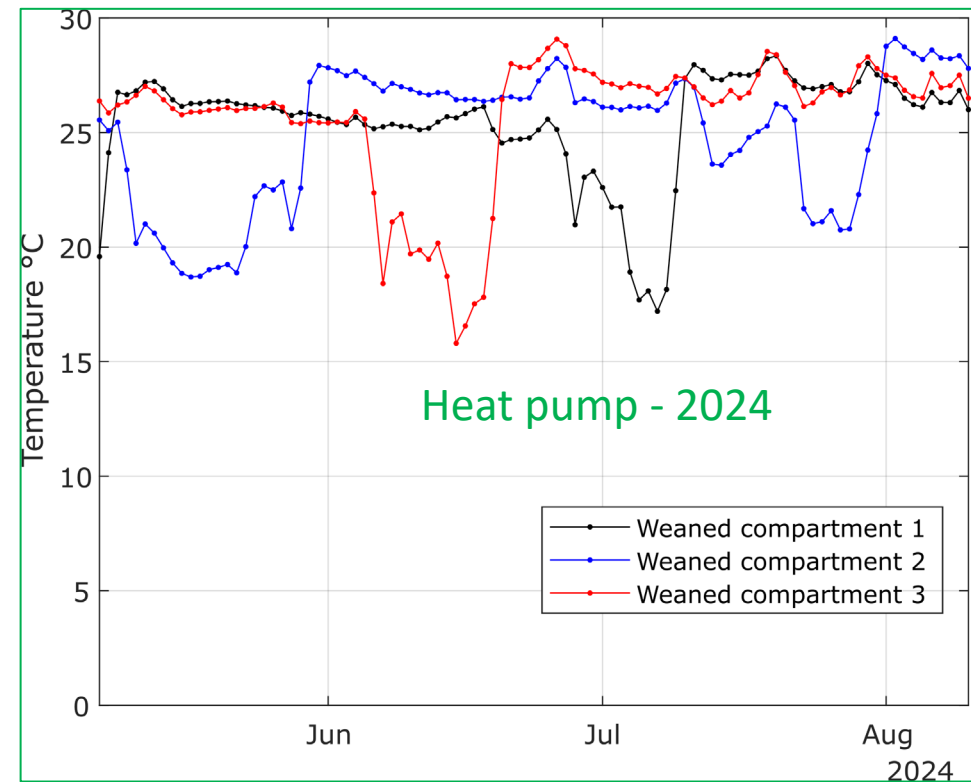
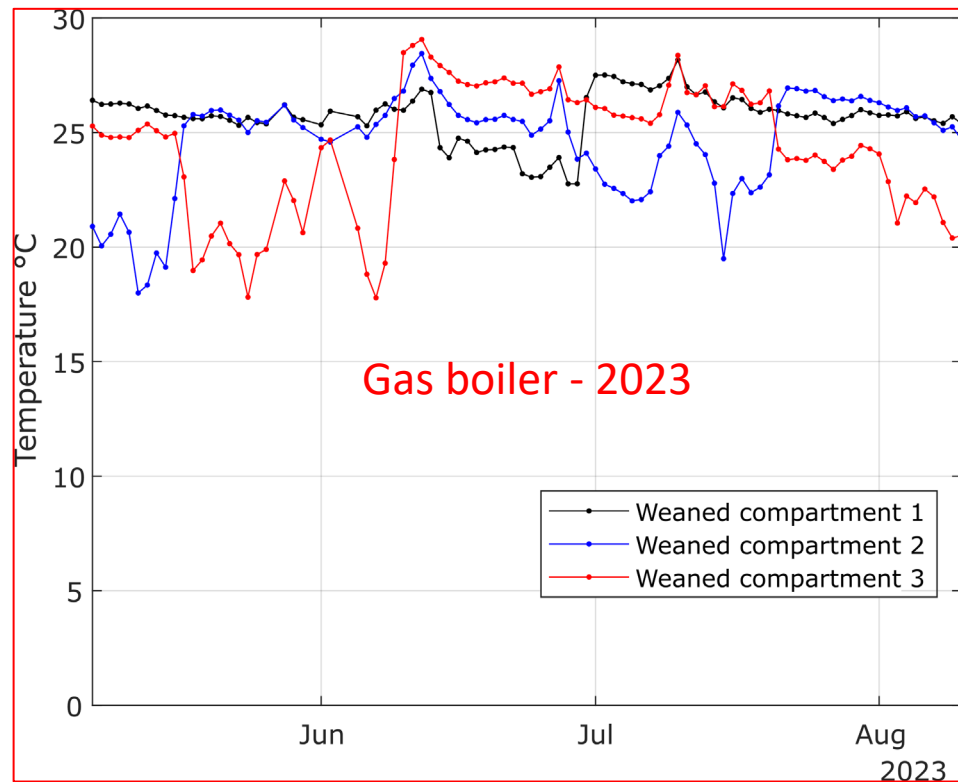


# Compartment level animal comfort - Gas boiler 2023

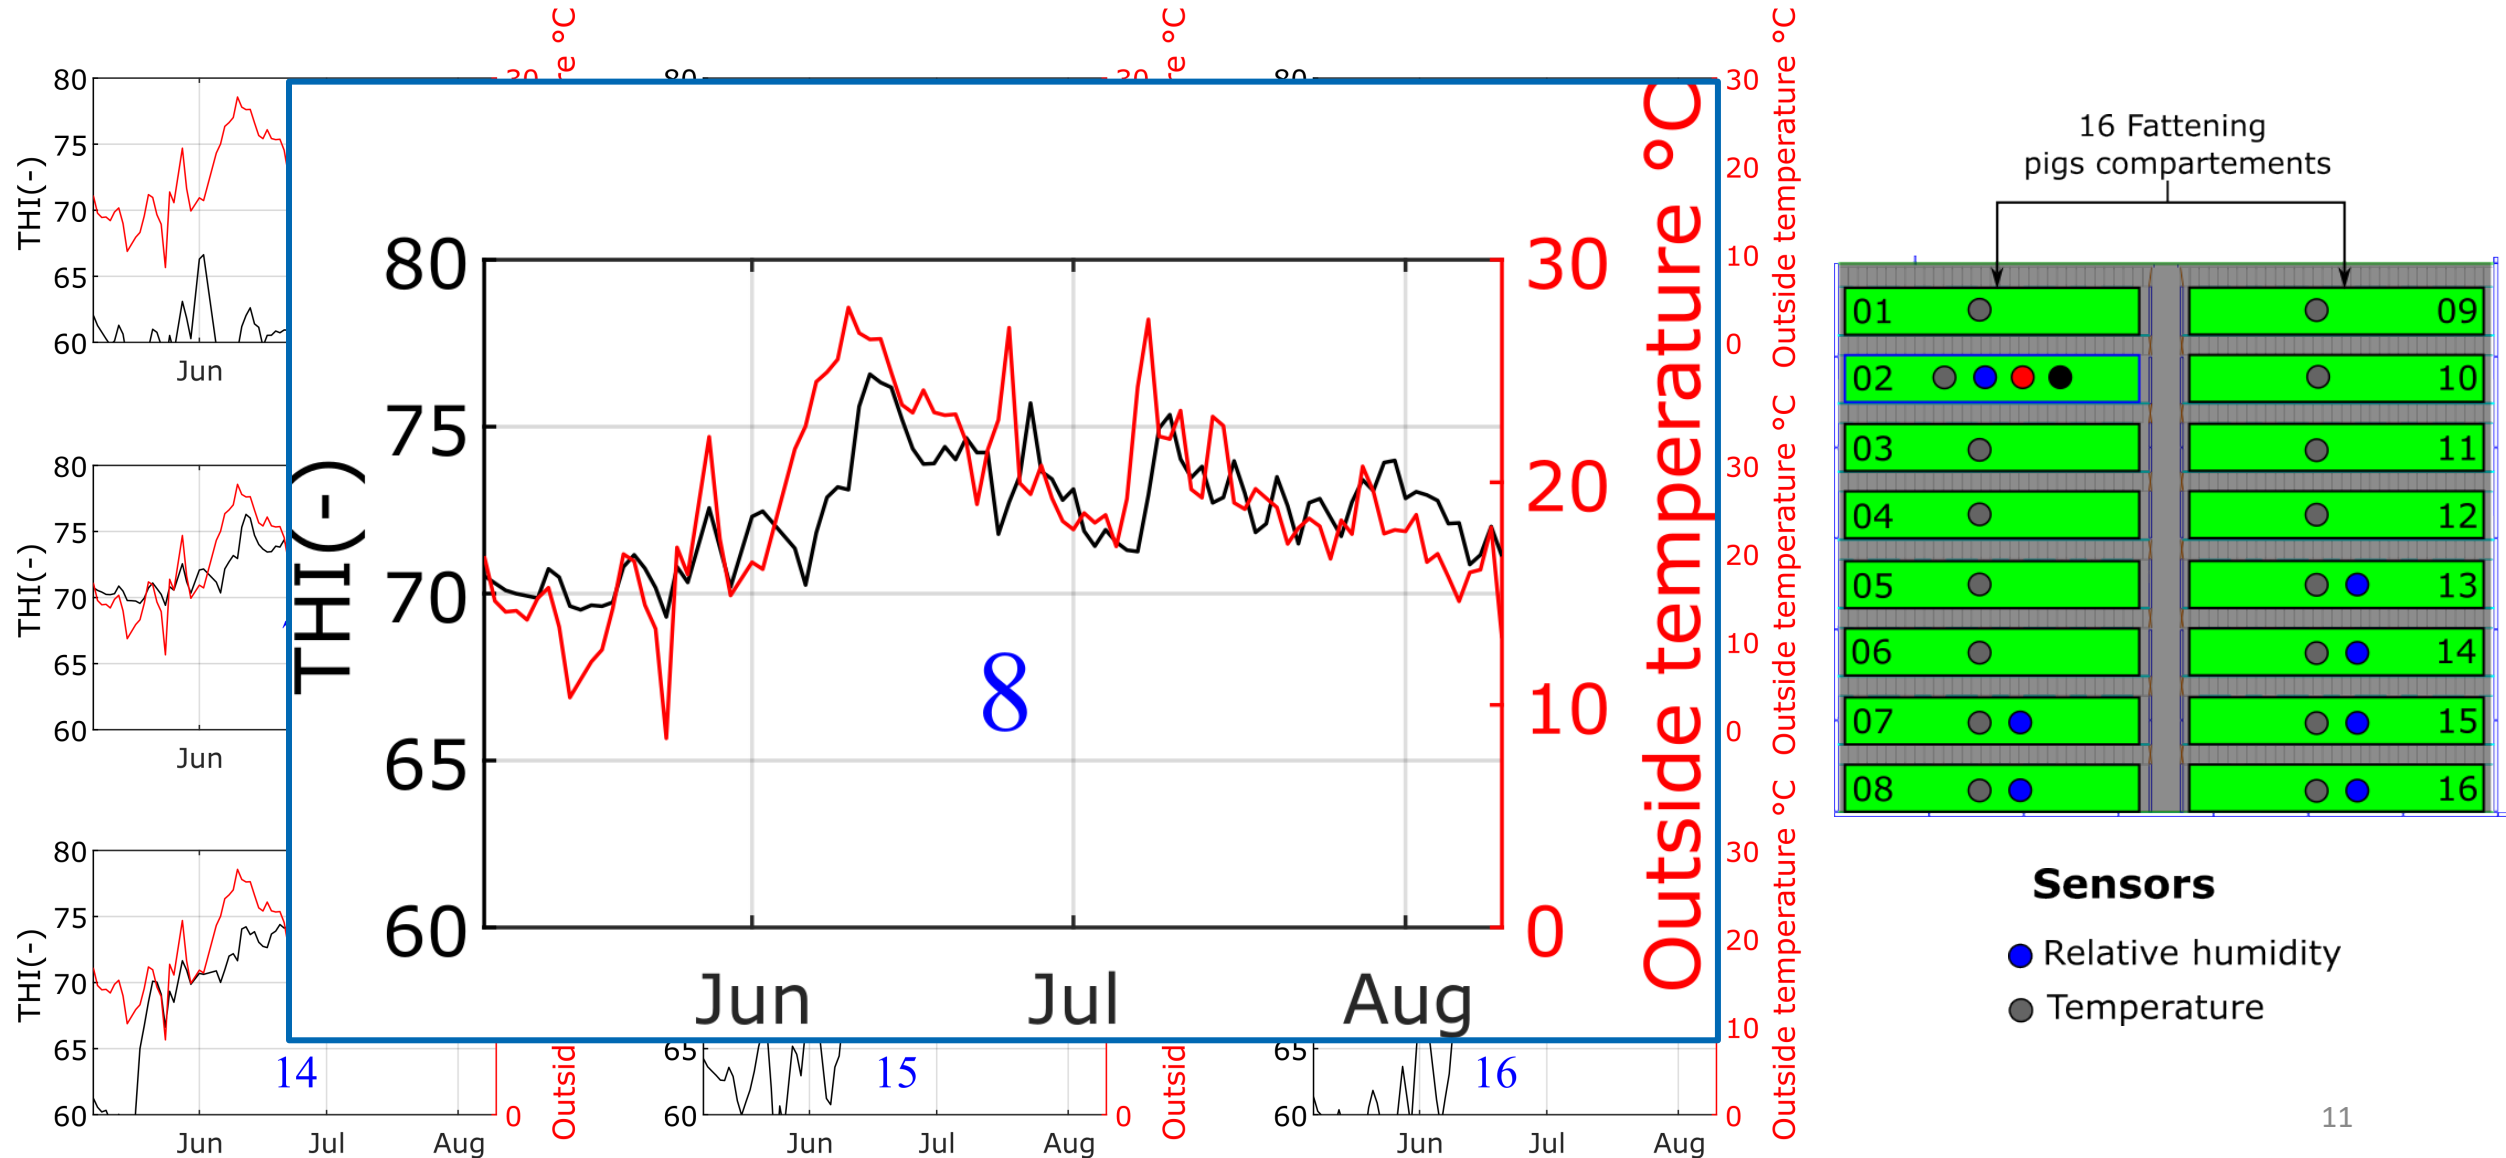




# Compartment level Animal comfort - Heat pump 2024

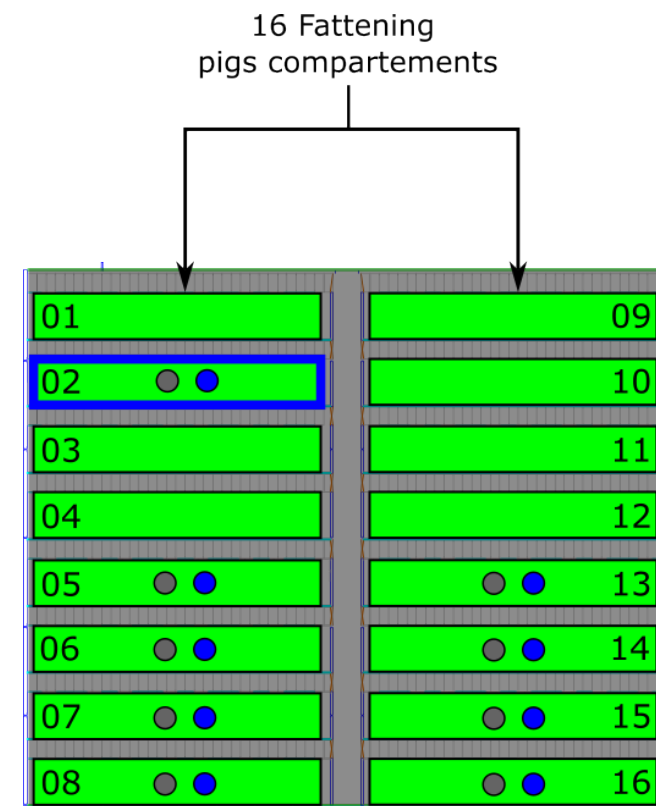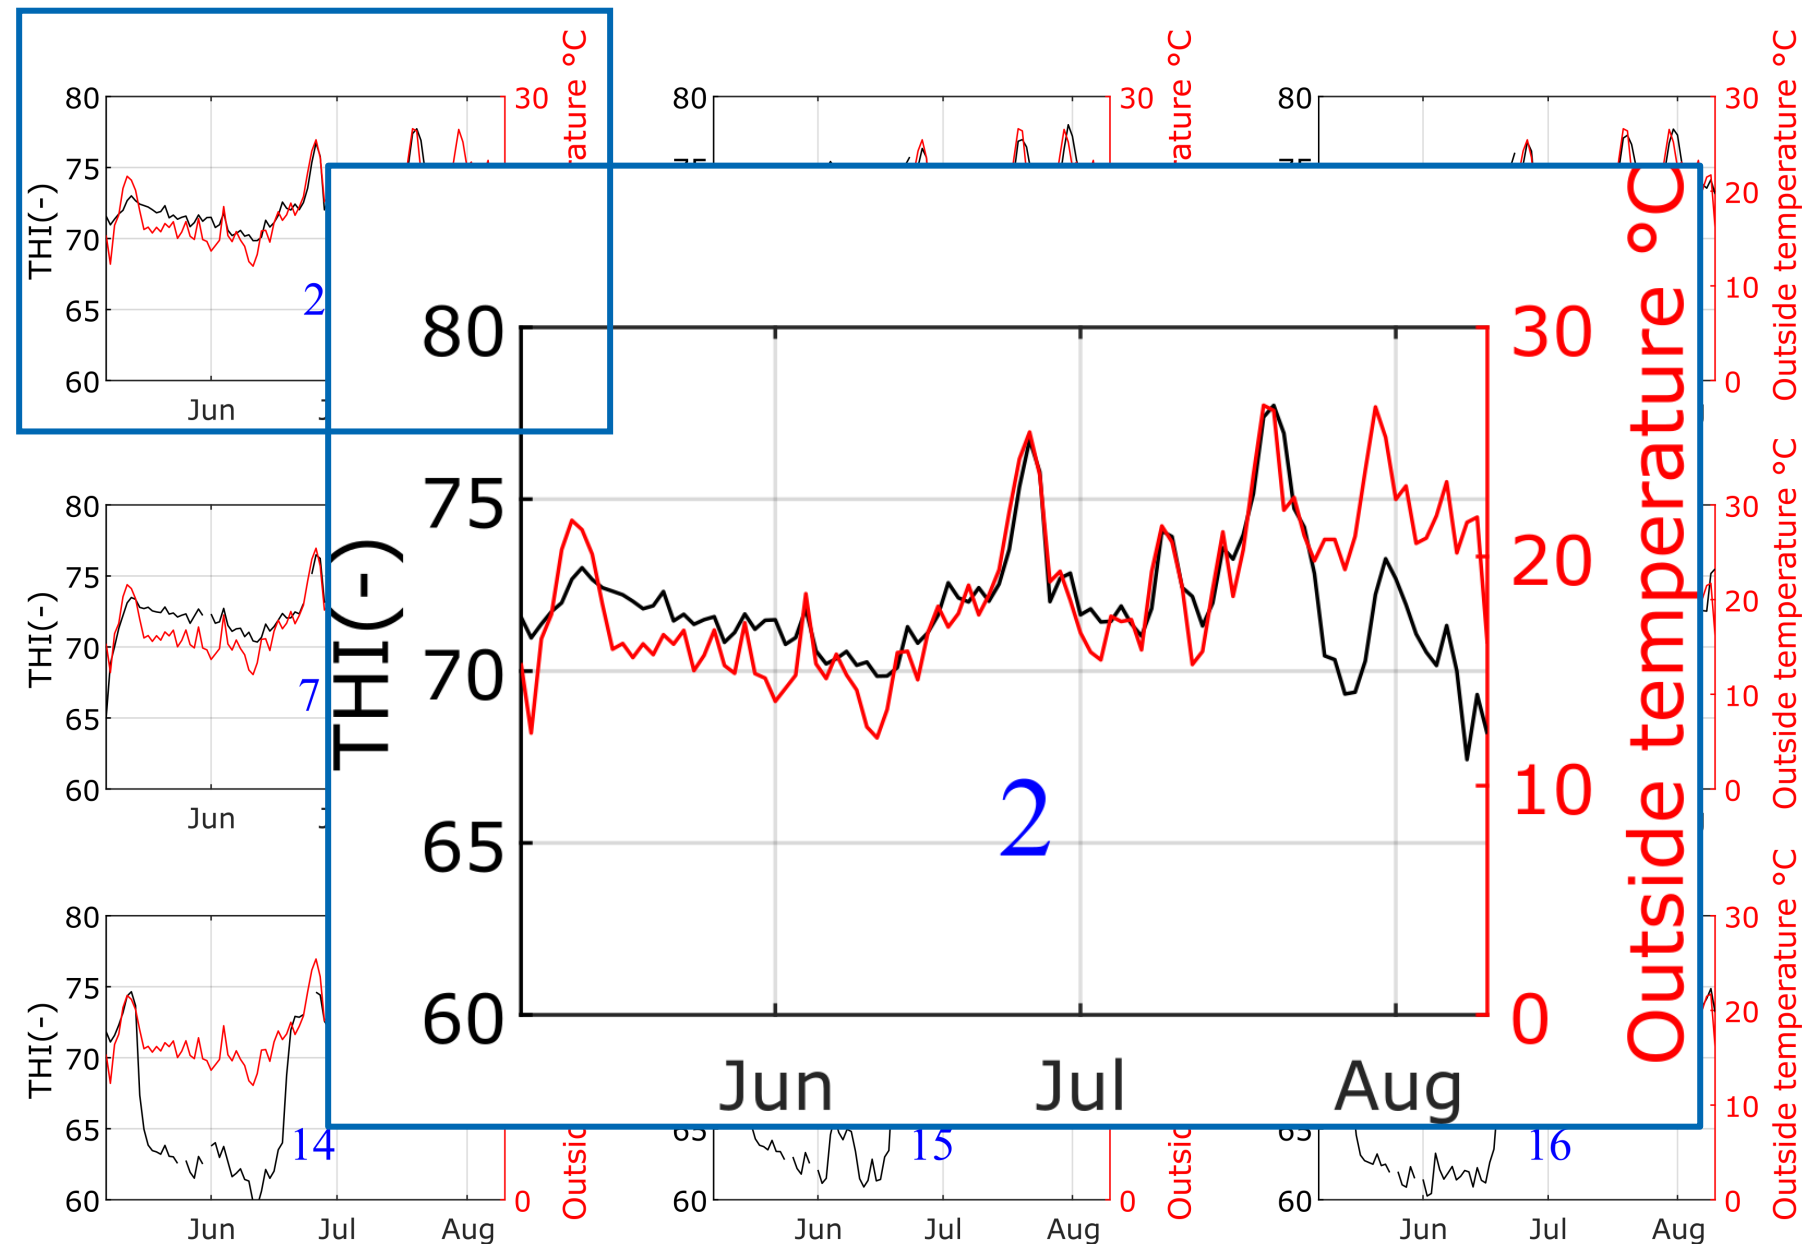

Heat pump 2024  
Average THI = 72  
T° outside = 19 °C

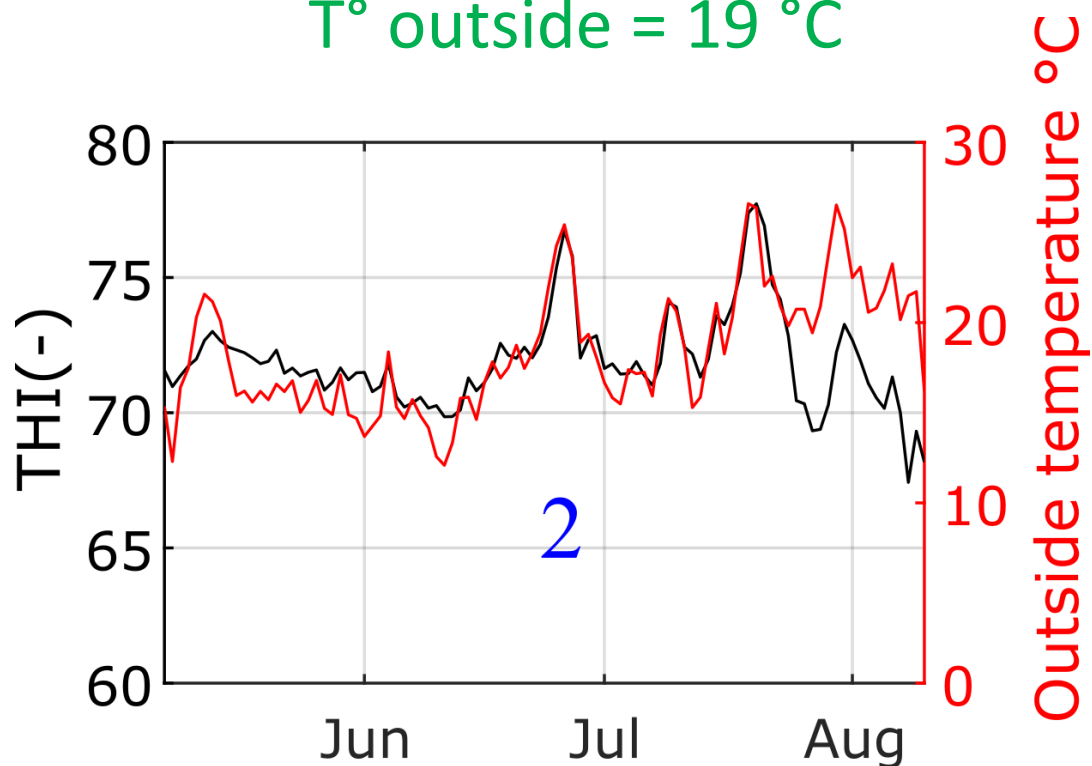

19/10/2024




This project has received funding from the European Union's Horizon 2020 research and innovation programme under grant agreement No.101000785

ww



Gas boiler 2023  
Average THI = 72  
T° outside = 18 °C

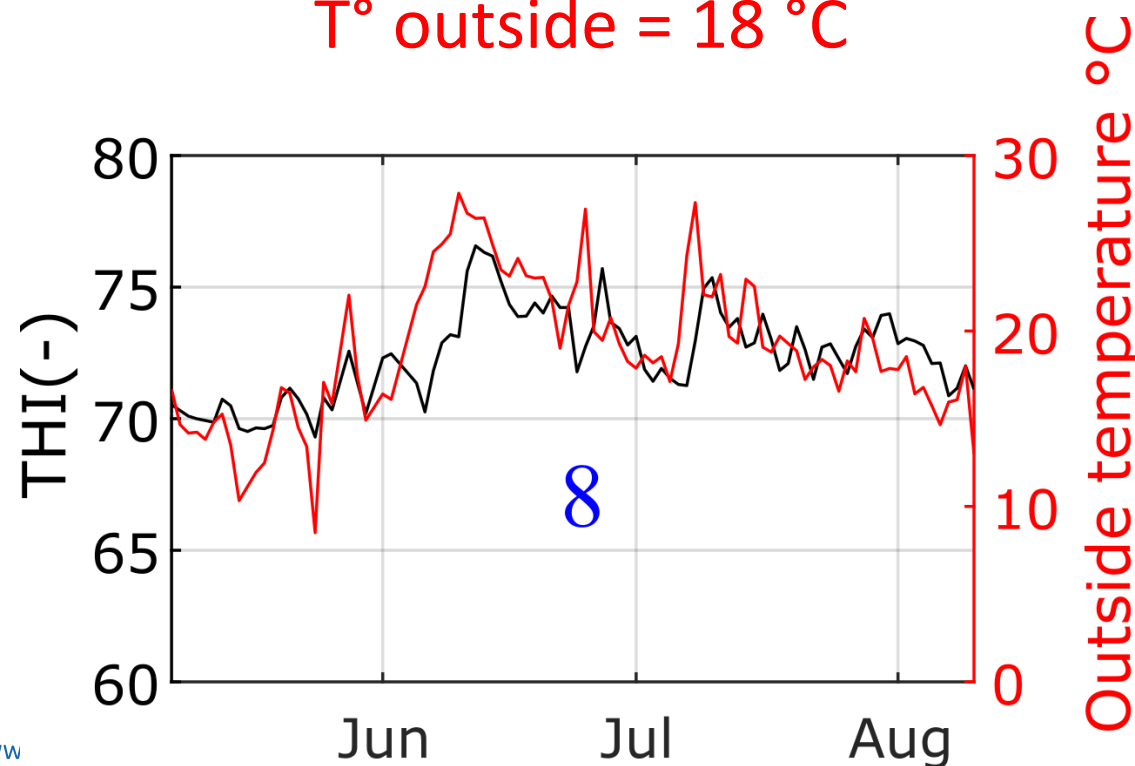

13

# Conclusion

- The temporal evolution of environmental conditions at animal compartments level is analyzed on a real life pig farm facility.
- The RES systems has supplied the required heating demand of the pig farm
- The THI and the temperature levels in the animal compartments is affected by the outside ambient conditions
- The findings underscore the effectiveness of the integrated heat pump and PVT system in supplanting the fossil fuel-based gas boilers on the farm.
- The need for modern dynamic controller is emphasized for an optimal operation of the RES systems installed



Thank you!

